


### HOOD SECTIONS

18

Scale: NO SCALE

M-500

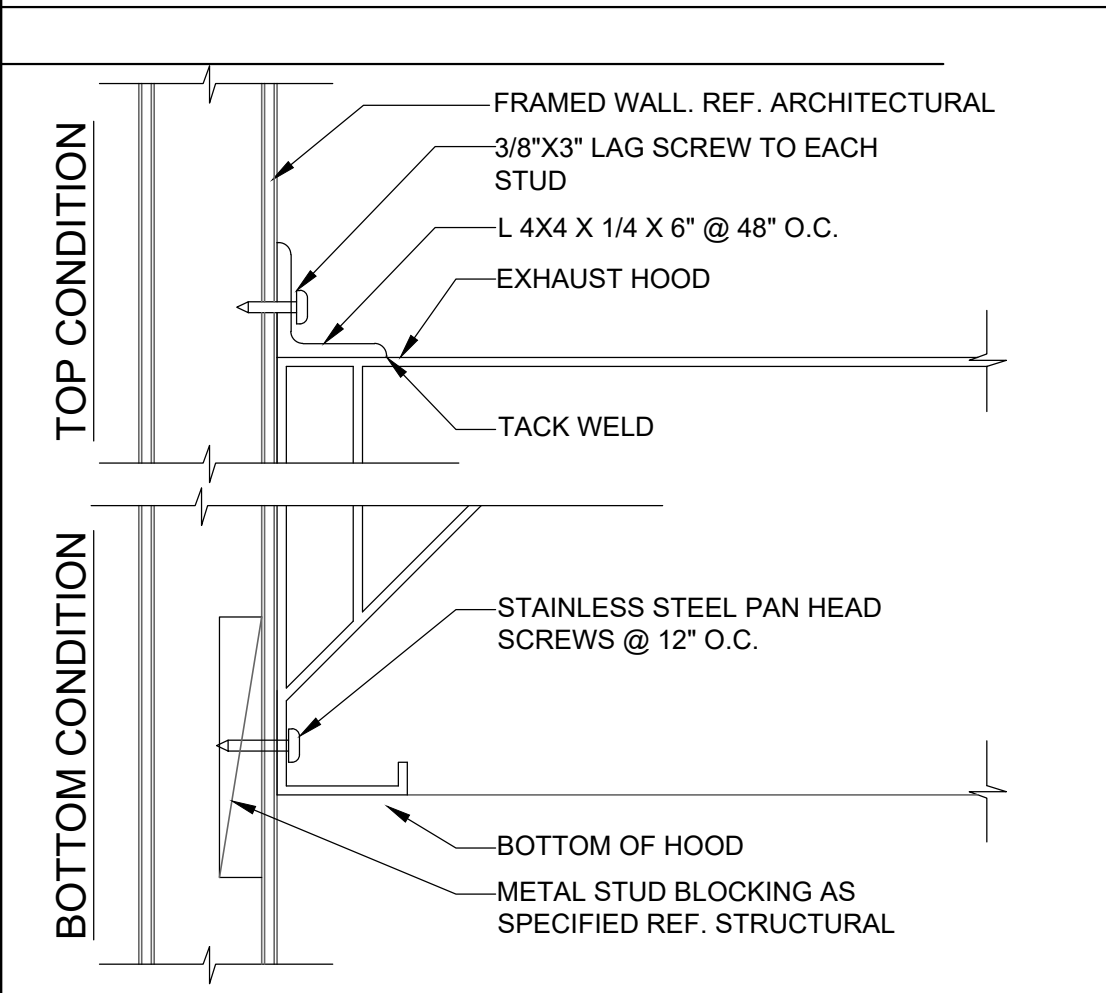


### HOOD CLIP AT WALL

14

Scale: NO SCALE

M-500

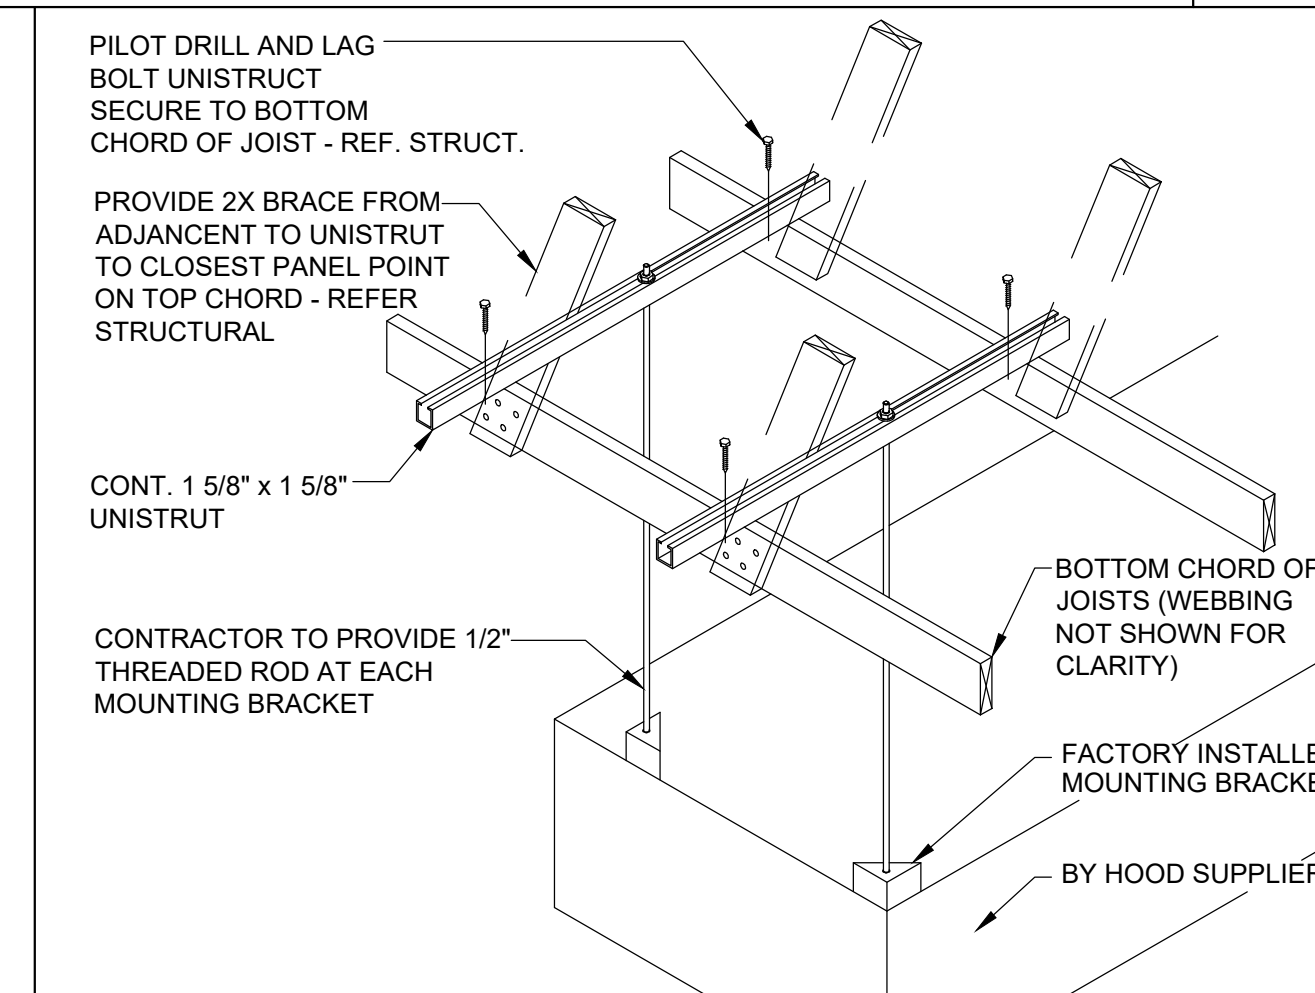

### HOOD SUPPORT AT TRUSS

13

Scale: NO SCALE

M-500

SYSTEM SHALL BE INSTALLED, PERFORMANCE TESTED, LISTED FOR MECHANICAL HOOD AND LABELED PER REQUIREMENTS FOR NFPA AND MANUFACTURER'S INSTRUCTION PER IFC 904.12.

### GREASE HOOD SYSTEM CALCULATION


1. TYPE : CANOPY TYPE I, STAINLESS STEEL 18 GAUGE.
2. COOKING EQUIPMENT: (2) CHINESE RANGE, (2) DEEP FRYER, RICE COOKER
3. SIZE: 23'-6" x 4'-0" + 2'-0" MAKEUP AIR PLENUM
4. MIN. REQ'D CAPACITY CFM: (2) U.L. LISTED HOOD @ 3,450 CFM EACH
5. PROPOSED (2) EXHAUST FAN & (1) MAKE-UP AIR UNIT. EF1 & EF2 (3,450 CFM EACH); MAU1 (5,520 CFM, 80% OF EXHAUST)
6. EXHAUST DUCT SIZE: 22"x14"
7. EXHAUST VELOCITY @ EXHAUST DUCT 3450/(22"x14"/144)= 1612 FPM 1500FPM < 1612 FPM < 2500FPM
8. EXHAUST FAN (EF1 & EF2) AND MAKE-UP AIR UNIT (MAU1) SHALL BE ELECTRICALLY INTERLOCKED
9. FOR CODE COMPLIANCE SEE DETAIL
10. FOR FILTER INFORMATION SEE CAPTIVEAIRE DWG #M-400.
11. INTERLOCK RTU FANS TO OPERATE WITH KEF'S FOR MAKEUP AIR.

### INFORMATIONAL GUIDE FOR COMMERCIAL COOKING HOODS


1. STAINLESS STEEL TO BE NO. 18 U.S. GAGE
2. WHEN GUTTERS ARE PROVIDED THEY SHALL DRAIN TO A COLLECTING PAN WHICH IS READILY ACCESSIBLE FOR CLEANING
3. SEE TABLE 507.11 FOR MINIMUM DISTANCE BETWEEN LOWER EDGE OF GREASE FILTER AND THE COOKING OR HEATING SURFACE.
4. GREASE FILTERS SHALL BE OF STEEL CONSTRUCTION AND READILY ACCESSIBLE FOR CLEANING.
5. ALL JOINTS AND SEAMS SHALL BE GREASE TIGHT.
6. HOODS SHALL BE SECURELY FASTENED IN PLACE BY INCOMBUSTIBLE SUPPORTS.

### NOTES

1. PROVIDE ADEQUATE CLEANOUT OPENINGS FOR THOROUGH CLEANING OF DUCT SYSTEM.
2. PROVIDE ADEQUATE MAKE-UP AIR FOR PROPER OPERATION.
3. PROVIDE A SEPARATE DUCT SYSTEM FOR EACH HOOD.
4. THICKNESS OF DUCTS SHALL BE:  
DUCT AREA      U.S. GAGE STEEL  
UP TO 4 SQ. FT.      16 GA  
OVER 4 SQ. FT.      14 GA
5. WELD OR BRAZE ALL DUCT JOINTS AND SEAMS ON THE EXTERNAL SURFACE.
6. SUPPORT THE DUCTS AS REQUIRED. DO NOT PENETRATE DUCT WALLS WITH SCREWS, NAILS, ETC.
7. SECTIONS OF DUCT SHALL NOT CONTAIN GREASE POCKETS.

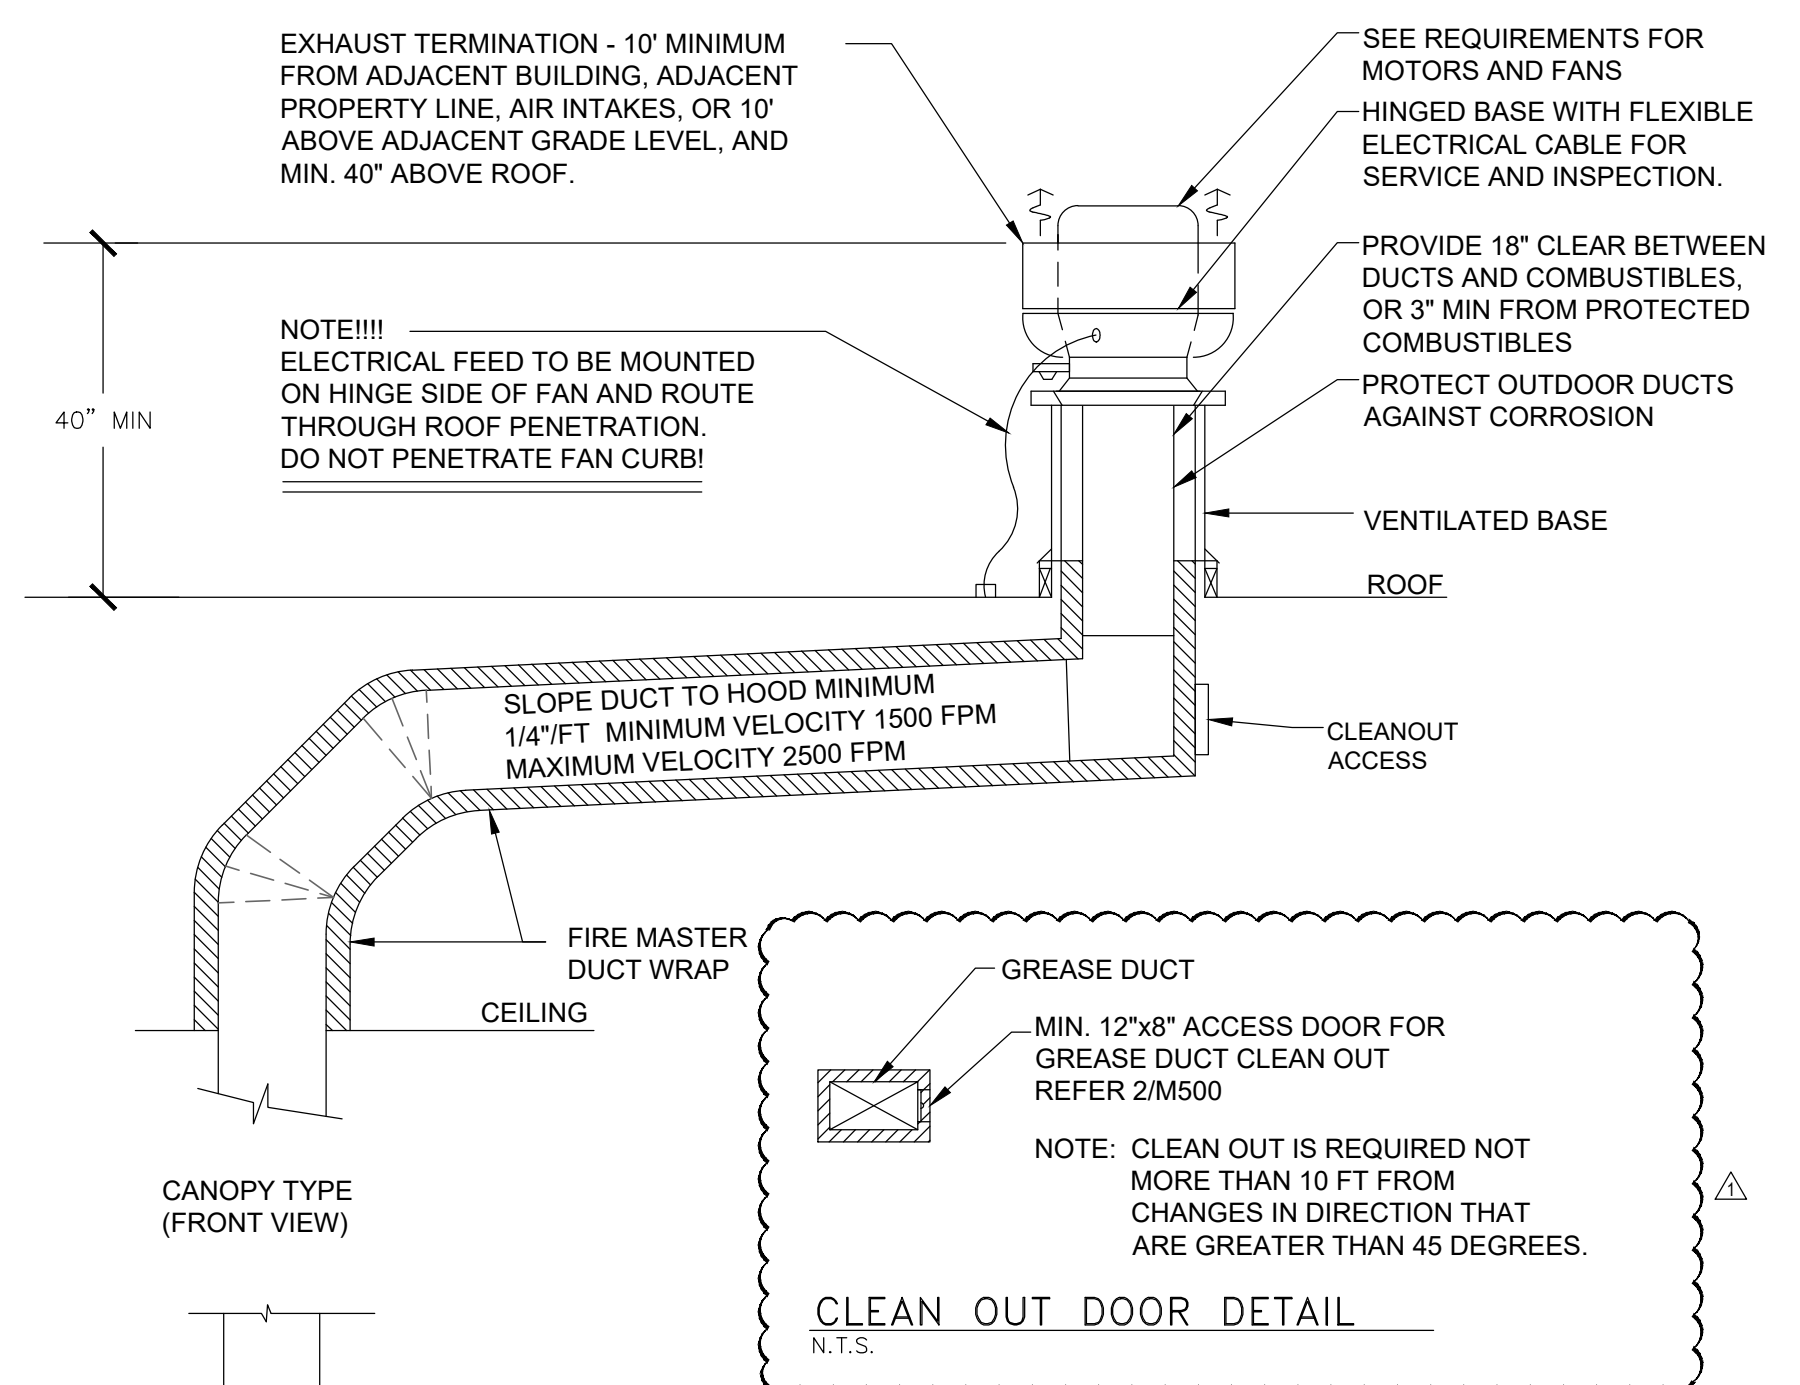


(FOR REFERENCE ONLY)

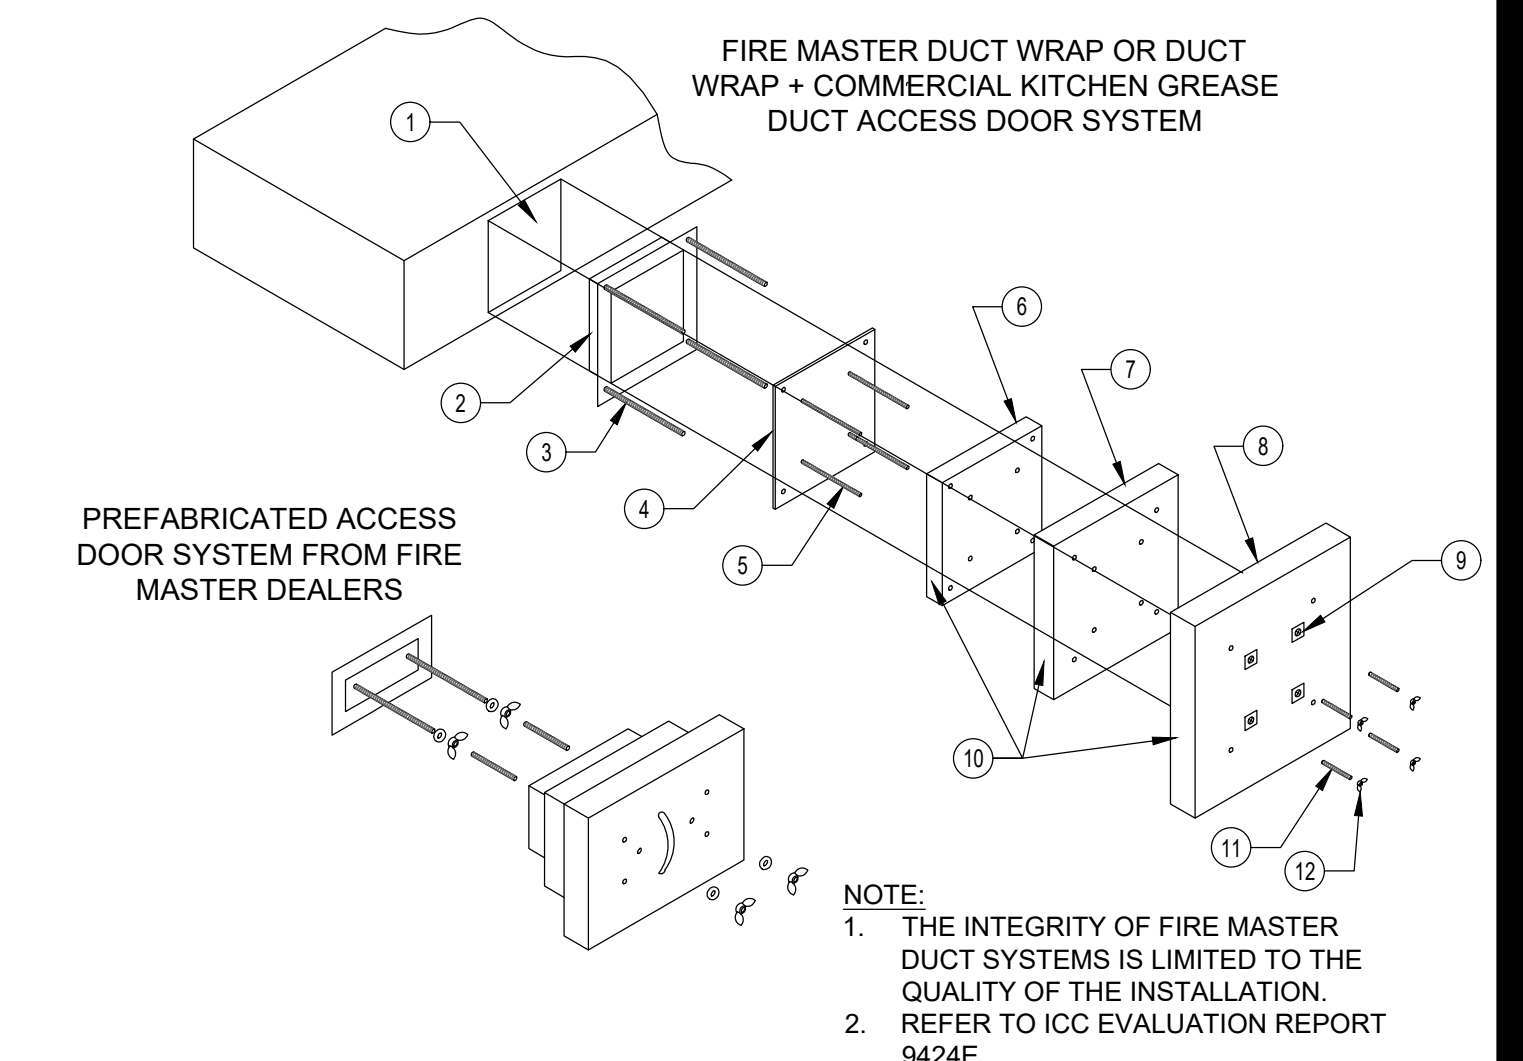

### GREASE DUCT ACCESS DOOR

2

M-500

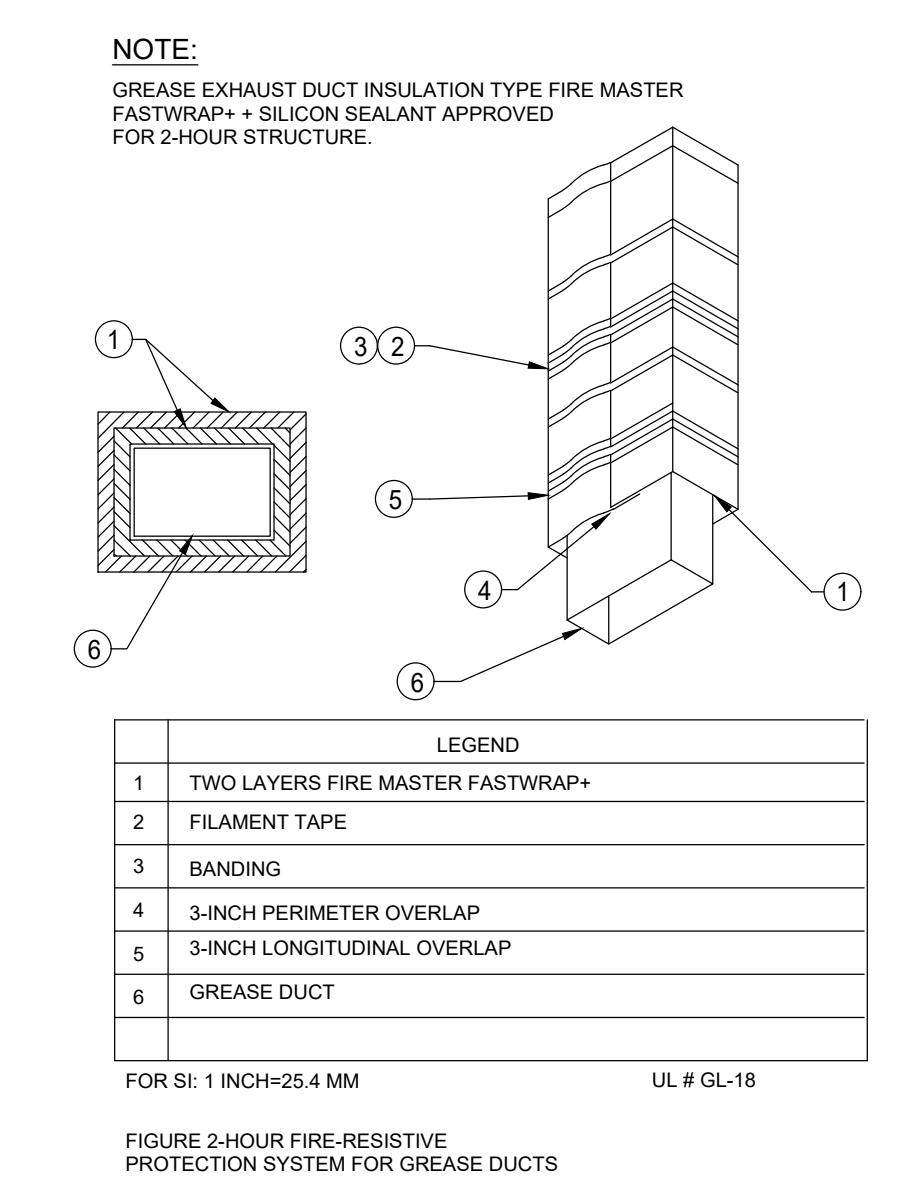

### 2 HOUR GREASE DUCT WRAP

1

Scale: NO SCALE

M-500